

HYDRAULIC LOADING:  
THREE (3) BEDROOMS AT 110 GALLONS PER DAY PER BEDROOM =  
330 GALLONS PER DAY.

SEPTIC TANK SIZE:  
AVERAGE DAILY FLOW = 330 G.P.D.  
MINIMUM STORAGE REQUIRED:  
COMPARTMENT #1 = 330 G.P.D. X 200% = 660 GAL.  
COMPARTMENT #2 = 330 G.P.D X 100% = 330 GAL.  
SEPTIC TANK PROVIDED = 1,500 GALLONS

PRIMARY LEACHING AREA:  
DESIGN PERCOLATION RATE = 2 M.P.I. (SOIL CLASS I)  
EFFLUENT LOADING RATE = 0.74 GALLONS/S.F.  
LEACHING AREA REQUIRED =  $330 \text{ GP} / 0.74 \text{ GP/S.F.} = 471 \text{ S.F.}$   
TOTAL LEACHING AREA PROVIDED = (3) LEACHING GALLEYS, 5.66' WIDE X 10.5' LONG X 2' DEEP WITH 1.5' STONE SIDEWALL AREA = 172.6 S.F.  
BOTTOM AREA = 297.7 S.F.  
TOTAL S.F. AREA = 470.3 S.F.  
TOTAL DESIGN FLOW = 470.3 S.F. X 0.74 GALLON/S.F. = 348 GALLONS.

1. FINISH GRADE SHALL BE DONE IN ACCORDANCE WITH THE PLOT PLAN. ALL DISTURBED AREAS SHALL BE COVERED WITH A MINIMUM OF 4" OF LOAM AND SEEDED WITH A NATIVE GRASS MIXTURE.
2. ALL EXCAVATIONS SHALL BE PROTECTED BY A FILL AND PUMP CHAMBER SHALL BE A MINIMUM OF 9 INCHES EXCLUDING TOPSOIL, PLACED IN LEFTS AND SUFFICIENTLY COMPACTED TO PREVENT DEPRESSIONS DUE TO SETTLING. BACKFILL OVER THE SOIL ABSORPTION SYSTEM SHALL BE FREE OF STONES AND Boulders GREATER THAN 6 INCHES IN SIZE.
3. ALL BUILDING SEWER SHALL BE LAID ON A COMPACTED FILL.
4. ALL PIPING SHALL BE MINIMUM OF SCHEDULE 40 UNLESS OTHERWISE NOTED.
5. ALL PIPE JOINTS AND CONNECTIONS TO SYSTEM COMPONENTS SHALL BE MECHANICALLY SOUND, WATER TIGHT AND PROTECTED AGAINST FLOODING.
6. ALL BUILDING SEWERS SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE STATE PLUMBING CODE 24B CMC 2002.
7. FILL/CONSTRUCTION SHALL BE GRADED TO REDUCE INFILTRATION OF SURFACE WATER AND MINIMIZE EROSION. FINISH GRADE SHALL HAVE A MINIMUM SLOPE OF 2%.
8. EFFLUENT DISTRIBUTION LINES SHALL HAVE A SLOPE OF 0.5%.
9. ALL EXCAVATIONS DEEPER THAN 4'-0" SHALL BE LEVEL FOR A MINIMUM OF TWO FEET OF THEIR LENGTH.
10. FILL MATERIAL FOR SYSTEMS CONSTRUCTED IN FILL SHALL CONSIST OF SELECT OR SILET OR IMPORTED SOILS THAT MEET THE MINIMUM REQUIREMENTS STATED IN 310 CMC 15.025(3).
11. ALL EXCAVATIONS OF NON-FLAMMABLE OR IMPERMEABLE SOILS, THE EXCAVATION OF THE UNSUITABLE MATERIAL SHALL EXTEND A MINIMUM OF 5 FEET LATERALLY IN ALL DIRECTIONS BEYOND THE OUTER PERIMETER OF THE SOIL ABSORPTION SYSTEM TO THE DEPTH OF THE EXCAVATION.
12. THE BOTTOM SURFACE OF THE EXCAVATION SHALL BE SCAFFERED AND RELATIVELY DRY. FILL SHALL NOT BE PLACED DURING RAIN OR SNOW STORMS. IF THE WATER TABLE ELEVATION IS ABOVE THE ELEVATION OF THE BOTTOM OF THE EXCAVATION, THE EXCAVATION SHALL BE DRAINED.
13. SUBSURFACE COMPONENTS OF A SYSTEM SHALL NOT BE BACKFILLED OR OTHERWISE CONCEALED FROM VIEW UNTIL A FINAL INSPECTION HAS BEEN CONDUCTED BY THE APPROVING AUTHORITY AND PERMISSION HAS BEEN GRANTED BY THE APPROVING AUTHORITY TO BACKFILL. BACKFILLING, IN ADDITION, THE FINAL INSPECTION OF THE SYSTEM SHALL BE CONDUCTED BY THE APPROVING AUTHORITY, THE SYSTEM INSTALLER AND THE DESIGNER PRIOR TO THE ISSUANCE OF A CERTIFICATE OF COMPLIANCE PURSUANT TO 310 CMC 15.021(3). ANY DEFECTS MUST BE CORRECTED PRIOR TO THE ISSUANCE OF THE CERTIFICATE OF COMPLIANCE.
14. ALL SUBSURFACE COMPONENTS SHALL BE MARKED WITH MAGNETIC MARKING TAPE OR A COMPARABLE MEANS IN ORDER TO LOCATE THEM ONCE BURIED.
15. ALL SOIL ABSORPTION SYSTEMS SHALL HAVE A MINIMUM OF ONE (1) INSPECTION PORT CONSISTING OF A PERFORATED FOUR (4) INCH PIPE PLACED SUFFICIENTLY DEEP TO THE NATURALLY OCCURRING SOIL OR SAND FILL BELOW THE STONE. THE PIPE SHALL BE CAPPED WITH A SCREW PIPE CAP AND ACCESSIBLE TO WITHIN THREE (3) INCHES OF FINISH GRADE.

1. CONTRACTOR TO VERIFY ELEVATION (\*) PRIOR TO THE START OF CONSTRUCTION AND REPORT TO ENGINEER ANY VARIATIONS IN ELEVATION TO THOSE SHOWN ON THIS PLAN.
2. EXISTING SYSTEM MAY BE ENCOUNTERED DURING THE INSTALLATION OF NEW SOIL ABSORPTION SYSTEM. (S.A.S.) REMOVAL, DISPOSAL AND UTILIZATION OF MATERIAL SHALL BE IN ACCORDANCE WITH THE TOWN OF TOWNSEND'S BOARD OF HEALTH RULES AND REGULATIONS.
3. EXISTING SEPTIC TANK AND LEACHING PIT, TO BE PUMPED, CRUSHED AND BACKFILLED WITH CLEAN GRANULAR MATERIAL AND/OR REMOVED IN ACCORDANCE WITH THE TOWN OF TOWNSEND'S BOARD OF HEALTH RULES AND REGULATIONS AND A NEW 1,500 GALLON SEPTIC SHALL BE INSTALLED.

I CERTIFY THAT I AM CURRENTLY APPROVED BY THE DEPARTMENT OF ENVIRONMENTAL PROTECTION PURSUANT TO 310 CMR 15.017 TO CONDUCT SOIL EVALUATIONS AND THAT THE ABOVE ANALYSIS HAS BEEN PERFORMED BY ME CONSISTENT WITH THE REQUIRED TRAINING, EXPERTISE, AND EXPERIENCE DESCRIBED IN 310 CMR 15.017. I FURTHER CERTIFY THAT THE RESULTS OF MY SOIL EVALUATION, AS INDICATED ON THE ATTACHED SOIL EVALUATION FORM, ARE ACCURATE IN ACCORDANCE WITH 310 CMR 15.100 THROUGH 15.107

*Jack Maloney*  
 LICENSED SOIL EVALUATOR:  
 WILLIAM J. "JACK" MALONEY, JR (S.E.# 13704)

DESCRIPTION	DRAWING ENTITY
Denotes existing contour (index)	100
Denotes existing contour (intermediate)	98
Denotes proposed contour (index)	100
Denotes proposed contour (intermediate)	98
Denotes limit of excavation of unsuitable soils	5' Exc.
Denotes proposed sewer line	S
Denotes proposed water line	W
Denotes proposed underground utilities	ETC
Denotes proposed building envelope	
Denotes proposed concrete septic tank	ST-1
Denotes proposed concrete pump chamber	PC-1
Denotes proposed concrete distribution box	DB-1
Denotes proposed sewer cleanout	C.O.

PREPARED BY:




OWNER:

DONNA LARSON TRUST OF 2013  
14 TERRACE WAY  
TOWNSEND, MASSACHUSETTS


APPLICANT:

DONNA LARSON TRUST OF 2013  
14 TERRACE WAY  
TOWNSEND, MASSACHUSETTS

SCALE:

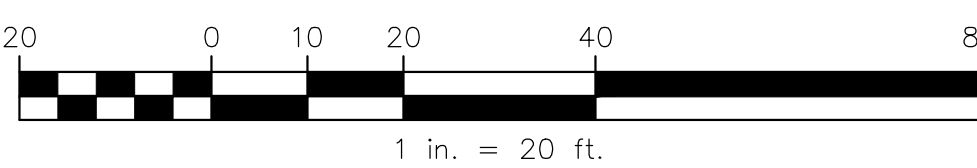

COPYRIGHT DUCHARME & DILLIS CIVIL DESIGN GROUP, INC 2020

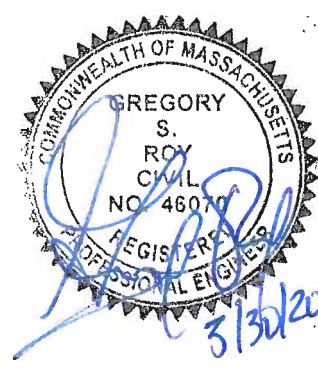

DATE:

3/4/2020

REGION BY

DESIGN BY: WJM

WJM

DRAWN BY:

WJM

CHECKED BY:

GSR

SEWAGE DISPOSAL SYSTEM DESIGN  
14 TERRACE WAY (M: 50, PCL: 44)  
TOWNSEND, MASSACHUSETTS

NO.	DATE	DESCRIPTION	BY
1.	3/30/2020	PIPE #2 LENGTH CORRECTION, TANK RISERS TO GRADE AS PER BOH REG. 16.2	WJM

JOB NO.

6336

DRAWING NO.

6336-SDS

SHEET NO.

SHEET NO. 4

1

1

OF 1